


### CUL mark


The green (ground), black (line) and white (neutral) wires of the AC line to the AC 120-277VAC.

For the strain relief at the canopy end, please use the UL listed strain relief devices.

NOTE: Dimming input.

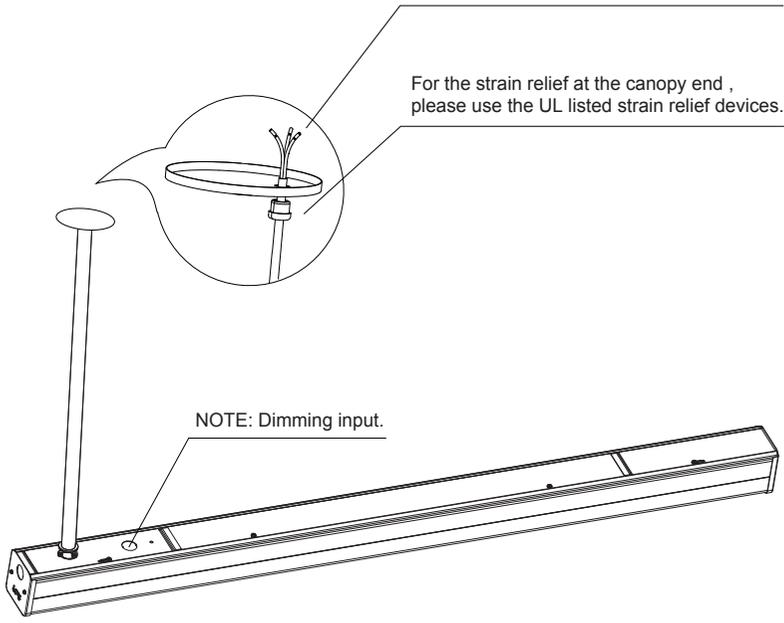

# PATH2

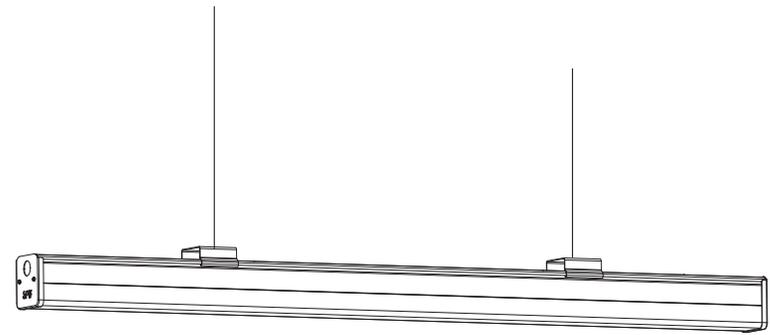

11/04/2019

**Instruction Manual**  
**Series: PATH2**

**ATTENTIONS**

**WARNING/AVERTISSEMENT**

**RISK OF ELECTRIC SHOCK**


- Turn power off before inspection, installation or removal.
- Properly ground electrical enclosure.

**RISK OF FIRE**



- Follow all NEC and local codes.
- Use only UL or IEC approved wire for input/output connections.
- Minimum size 18 AWG.

**THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED**


Dimension: (Inches/mm)




Model	Rated Input	length	Power	Minimum Mounting Space (LXWXH)	Max. Linkabe No.	ta
PATH2-L120-277V	120~277VAC	1200 (47-1/4")	40W	1300X300X300 (51-3/16"X11-13/16"X11-13/16")	40 @120VAC 75 @277VAC	-20°C~35°C (-4~95°F)
PATH2-L240-277V	120~277VAC	2398 (94-1/2")	80W	2500X300X300 (98-7/16"X11-13/16"X11-13/16")	20 @120VAC 37 @277VAC	-20°C~35°C (-4~95°F)

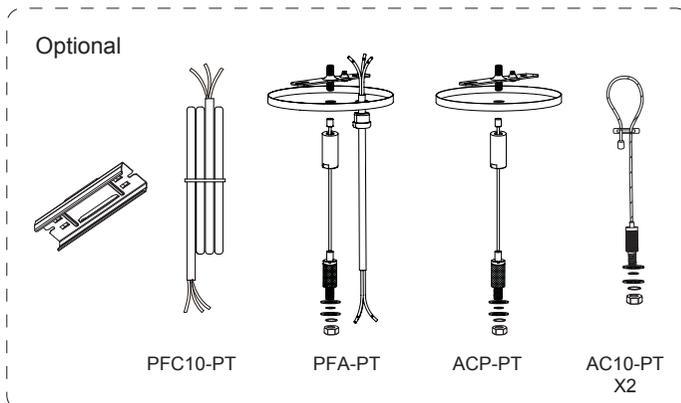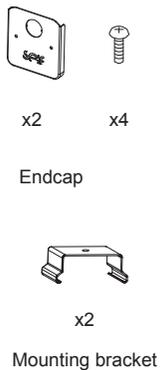






**Tools**

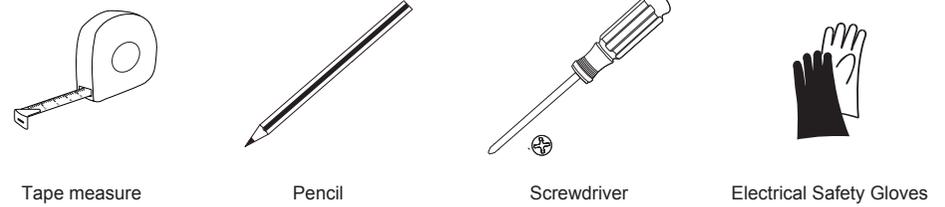


**Installation Optionals**

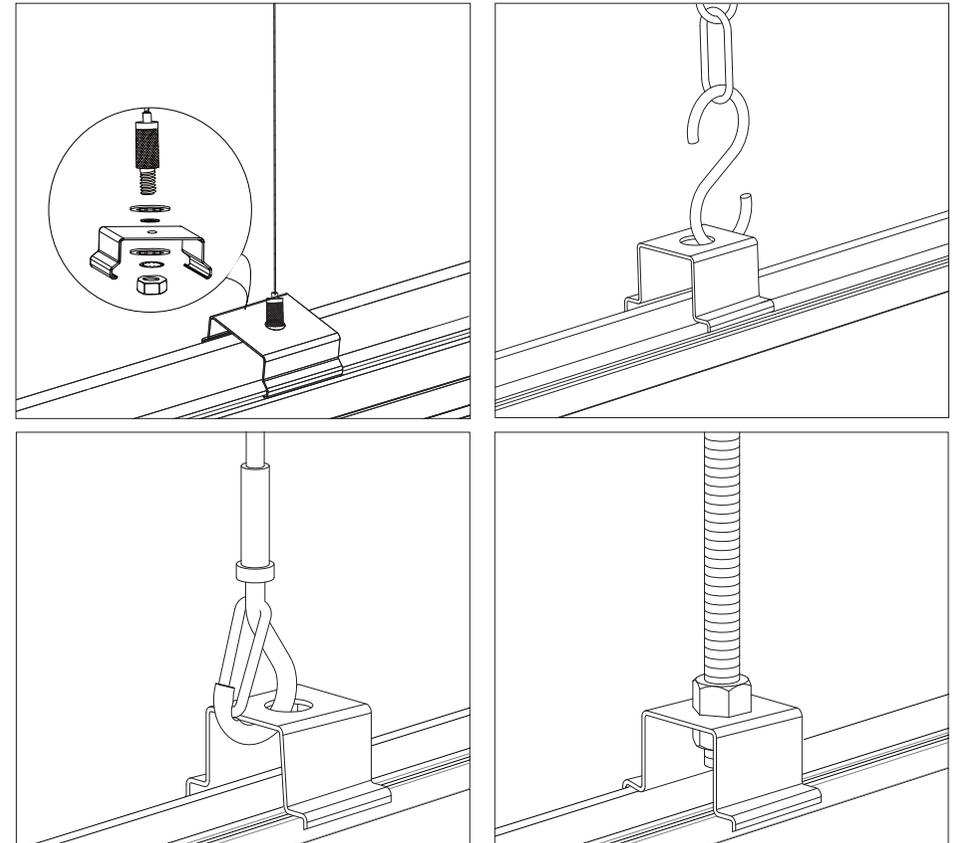


## Installation

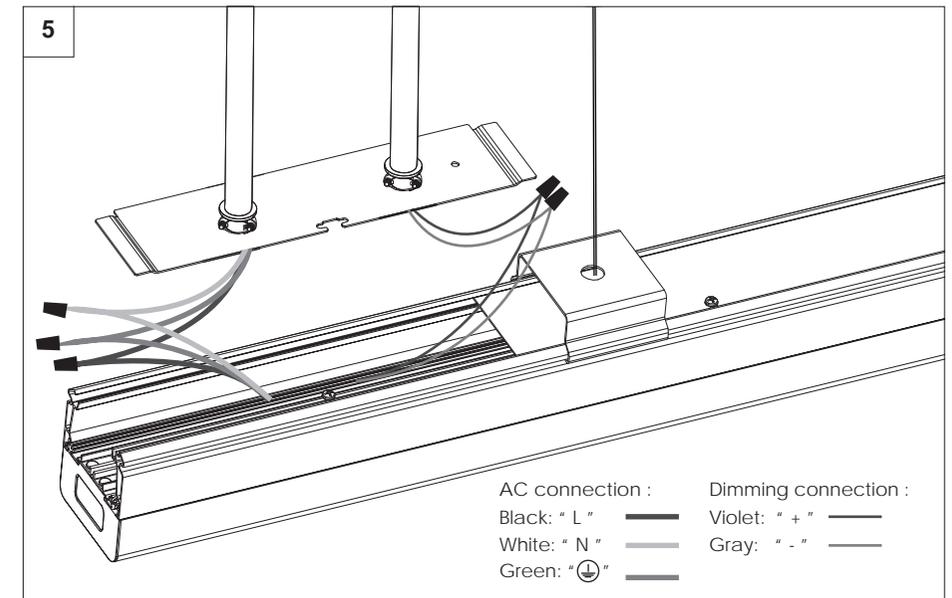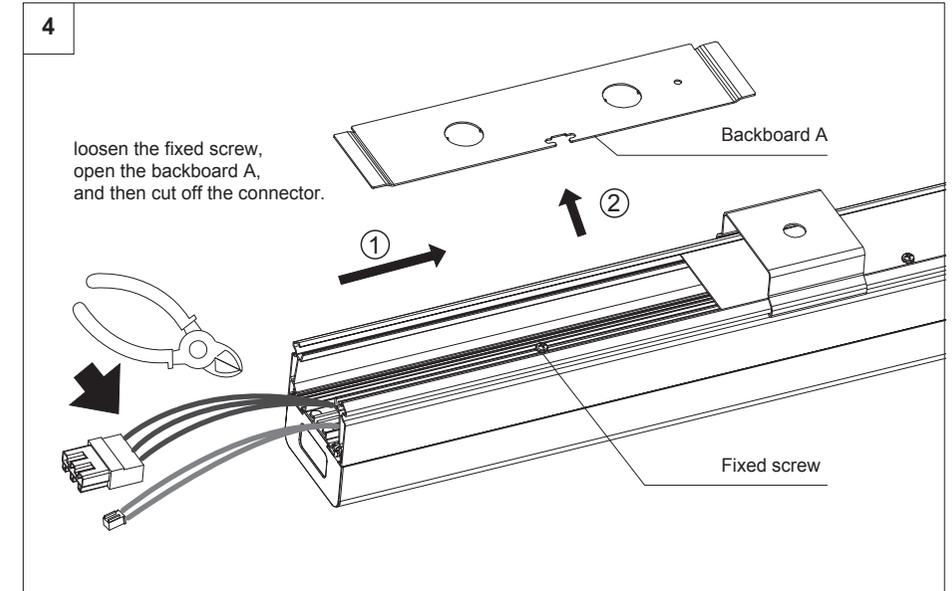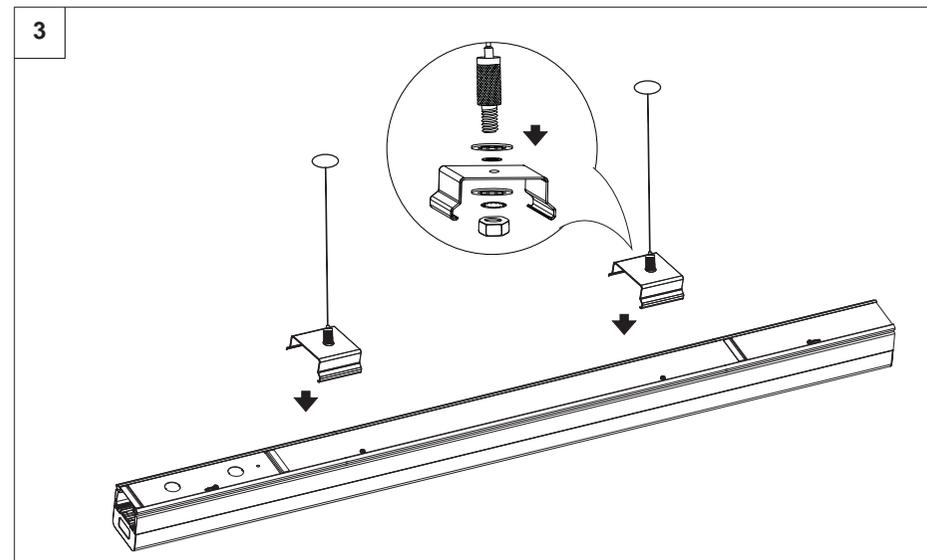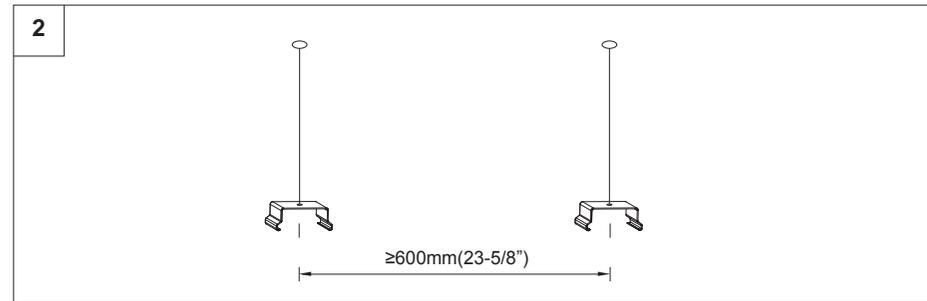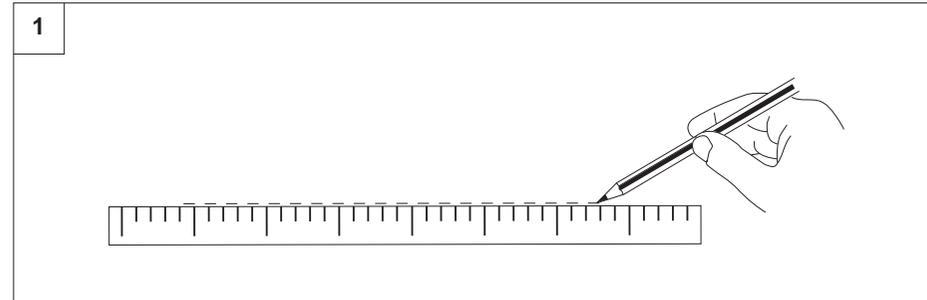

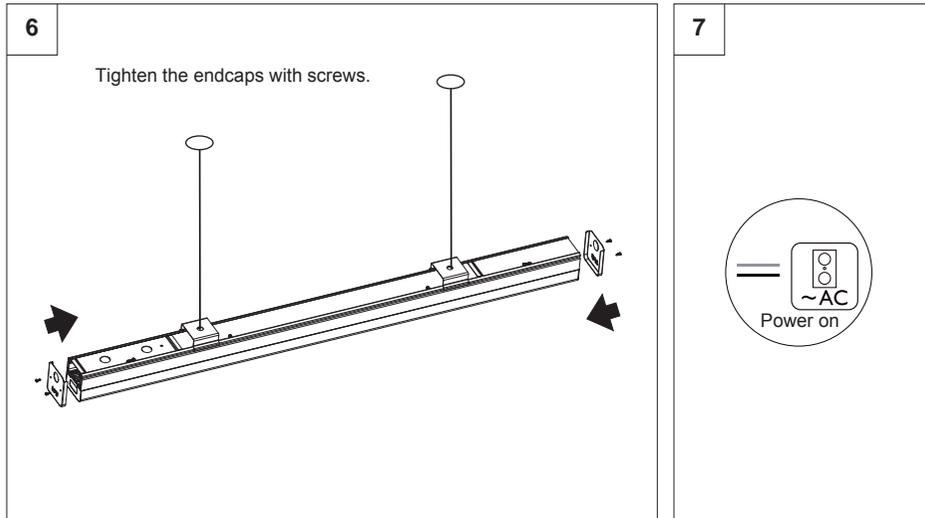

### Dimmer

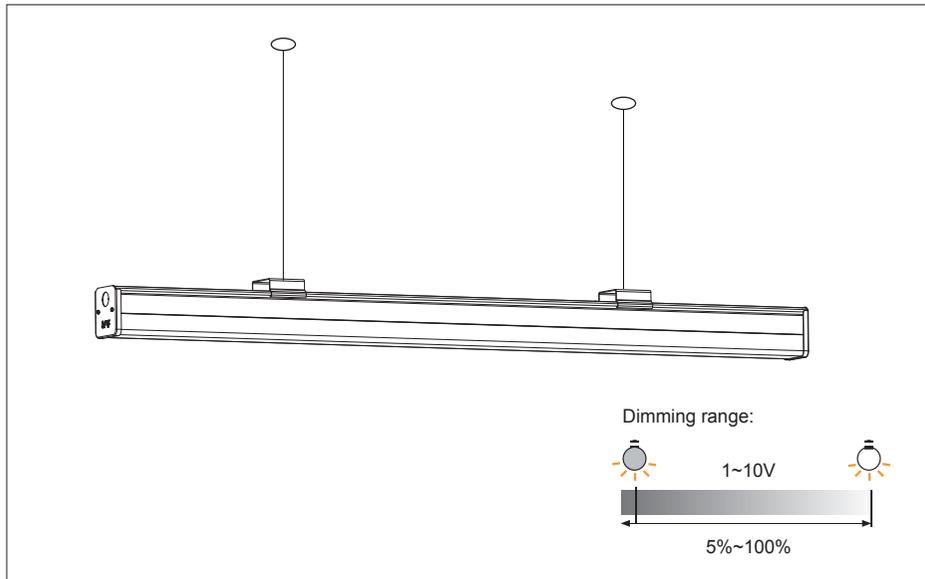

### Continuous Run Installation

